


NOTES:


1. SDR-26 HEAVY WALL SEWER PIPE SPIGOT END OF ADAPTER SHALL HAVE A MINIMUM WALL THICKNESS EQUAL TO SDR-26.
2. TYPICAL SINGLE RESIDENTIAL SERVICE IS 4" DIA.
3. COMMERCIAL/INDUSTRIAL SERVICE SHALL BE 6" OR GREATER. MONITORING MANHOLE SHALL BE REQUIRED AS DIRECTED, IN LIEU OF CLEANOUT.
4. SDR-26 MAIN SHALL UTILIZE A STD. SDR-26 TEE IN LIEU OF A TEE-WYE.
5. SDR-26 HW SEWER PIPE MAY BE REQUIRED DEPENDING ON FIELD CONDITION ON THE DESCRETION OF THE BCPSSD INSPECTOR.
6. ONE SIX INCH CLEANOUT MAY BE USED OR TWO FOUR INCH AT THE DISCRETION OF BCPSSD INSPECTOR.

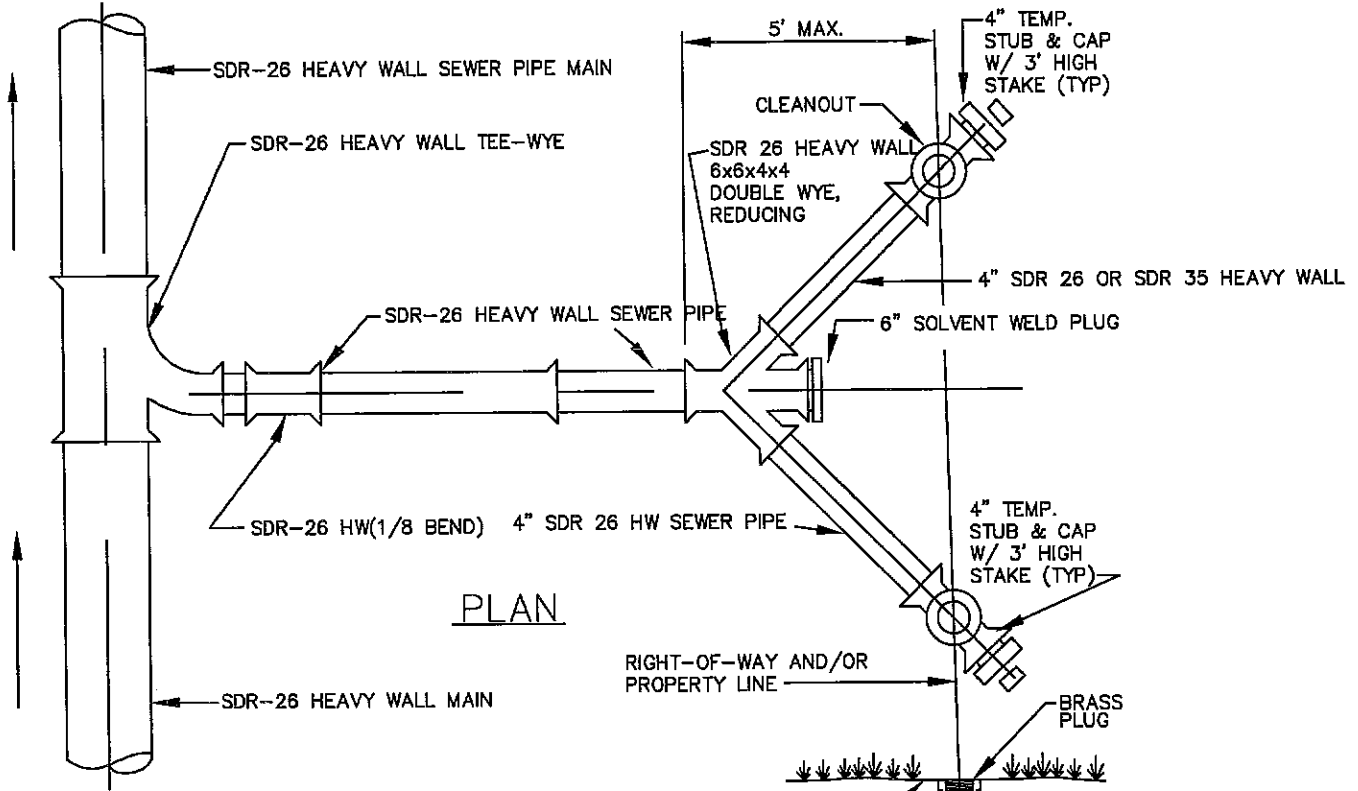

PLAN

NOTES:

1. SDR-26 HEAVY WALL SPIGOT END OF ADAPTER SHALL HAVE A MINIMUM WALL THICKNESS EQUAL TO SDR-26 HW.
2. SDR-26 HW MAIN SHALL UTILIZE A STANDARD SDR-26 HW TEE IN LIEU OF A TEE-WYE.

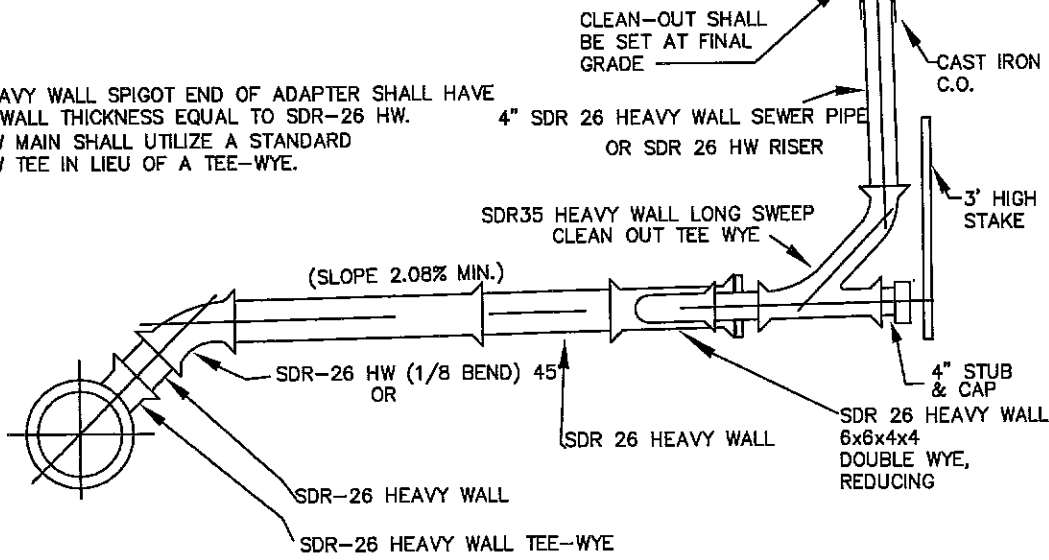

PROFILE

NOT TO SCALE

CONVENTIONAL GRAVITY
DOUBLE SERVICE LATERAL

REVISION DATES

REVISION DATES

BERKELEY COUNTY PUBLIC
SERVICE SEWER DISTRICT

APRIL 2008